



CENTRO DI RICERCA E SPERIMENTAZIONE
PER L'INDUSTRIA CERAMICA

Bologna, 24/01/2020

*NICHELCROM ACCIAI INOX
S.p.A.
Via Trento 96/100
20099 SESTO SAN
GIOVANNI (MI)*

TEST LABORATORY
TEST REPORT No. 2120/20

Requested by:	NICHELCROM ACCIAI INOX S.p.A. Via Trento 96/100 20099 SESTO SAN GIOVANNI (MI)
On (date):	18/12/19
For the sample marked:	"Acciaio inossidabile 304 in finitura satinata grana 40".

The results reported relate only to the samples tested.

No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision.

**The reproduction of this test report is only authorized in the form of a complete photographic facsimile.
Our written approval is necessary for any partial reproduction.**

The texts in inverted commas are Customer's declarations and fall under his responsibility.

This test report consists of 3 pages this cover included.



DESCRIPTION OF THE SAMPLE: Metal slab 50 x 100 x 0.2 cm, marked "Acciaio inossidabile 304 in finitura satinata grana 40".	
Manufacturer:	-----
Sampling details*	
- Where:	-----
- Date:	-----
- By whom:	CUSTOMER
- How (methods):	-----
Date of receipt in laboratory:	17/01/20

TESTS PERFORMED :

			Date of starting	Date of ending
<input checked="" type="checkbox"/>	DIN 51130 (06/2004)	Determination of the anti - slip properties – Workrooms and fields of activities with raised slip danger, walking method – ramp test	20/01/20	20/01/20

* The sampling is excluded from accreditation.




DIN 51130 (06/2004)- Determination of the anti - slip properties – Workrooms and fields of activities with raised slip danger, walking method – ramp test

- Surface characteristics
- Smooth
 - Profiled
 - Structured
 - Rough

OPERATIVE CONDITIONS

Fixing scheme

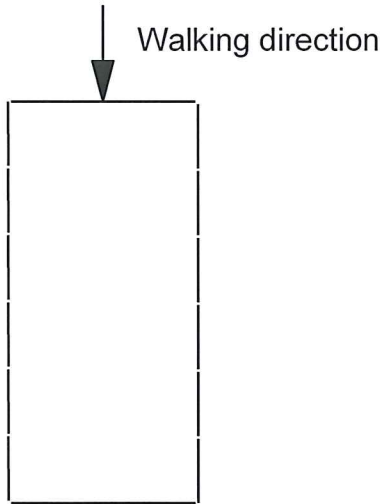


RESULTS:

Average total acceptance angle:	29.2°
Movement area (cm ³ /dm ²):	---

CLASSIFICATION (DGUV REGEL 108-003)

Group of anti - slip properties:	R12
Movement area evaluation group:	---

Pietro Bruzzi
Technical verification



Prof. Maria Chiara Bignozzi

Director

End of report